



# Safe-Lec 2 Copper Bar


## Copper Conductor Bars with Splice Installed

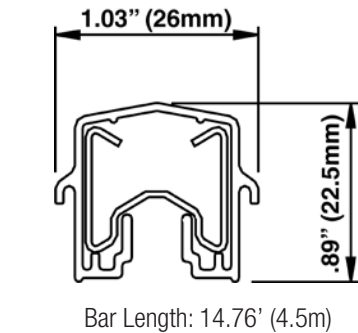

COVER TYPE	CURRENT RATING		
	160A	250A	400A
Standard Phase Cover (Orange)	310301-J	310401-J	310501-J
Standard Ground Cover (Green)	310302-J	310402-J	310502-J
Medium Heat Cover (Red)	310303-J	310403-J	310503-J
UV Stable (Black)	310301B-J	310401B-J	310501B-J
Wt lb (kg)	6 (2.7)	7.1 (3.2)	10.0 (4.5)

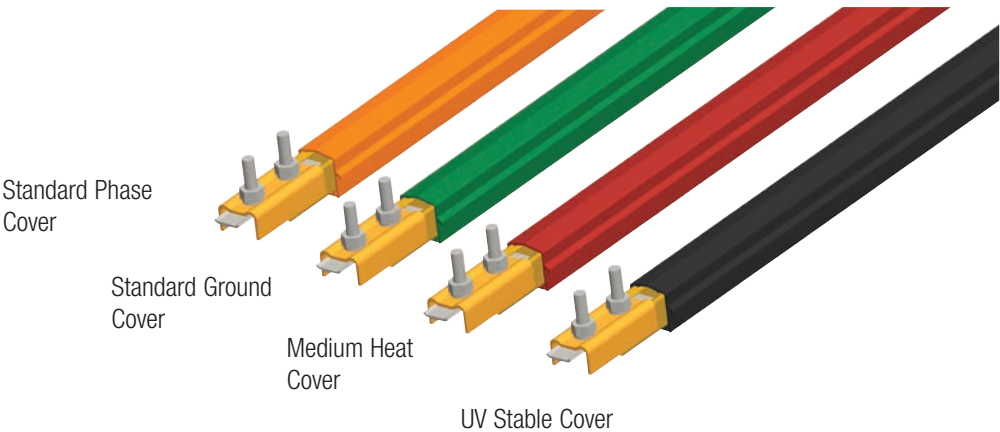

## Expansion Sections with Splice Installed

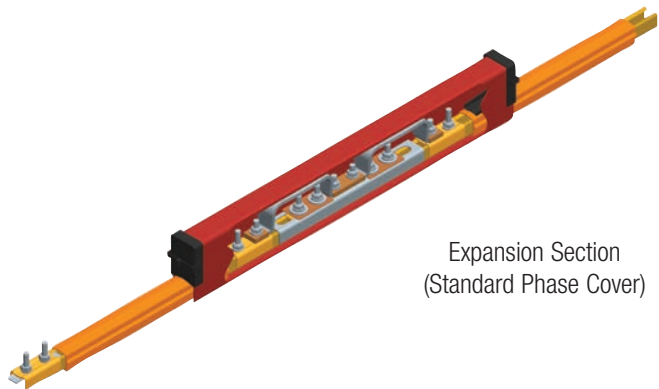

Expansion Sections are used at all structural expansion joints and for systems longer than 492 ft. (150m) to allow for thermal expansion / contraction of the bar. The maximum gap of the Expansion Section is 2.0" (50 mm). The Expansion Section is 14' 9" (4.5 m) long and is installed in place of one length of conductor bar.

COVER TYPE	CURRENT RATING		
	160A	250A	400A
Standard Phase Cover (Orange)	310307-J	310407-J	310507-J
Standard Ground Cover (Green)	310308-J	310408-J	310508-J
Medium Heat Cover (Red)	310309-J	310409-J	310509-J
UV Stable (Black)	39132-J	39133-J	39134-J
Wt lb (kg)	9 (4.1)	9 (4.1)	11 (4.98)